

Measurement of Partial Discharge inside Metal Enclosed Power Apparatus using Internal Sensor

Umar Khayam¹, Yushan²

¹School of Electrical Engineering and Informatics
Bandung Institute of Technology
Bandung, Indonesia

²PT PLN Persero, Indonesia

¹umkha@yahoo.com, ²yushan.yusuf@gmail.com

Abstract—Partial discharge detection by detecting the released energy in form of electromagnetic wave during discharge using Ultra-High Frequency (UHF) antenna is one method to determine insulation system quality in high voltage system. UHF PD detection method has several advantages over conventional PD detection system such as IEC 60270 method. The advantages of UHF PD detection system are the capability to directly detect PD signal without firstly shut down, the installation system and their immunity from environmental noise. Nowadays most of electrical equipment are in form of metal enclosed model. This paper deals with measurement of PD occurrences inside metal enclosed equipment using internal sensor. The loop antenna is used for PD measurement. The experimental results show that the presence of metal box gives significant change on the PD signal detected by using loop antenna. Without metal box, the measurement sensitivity decreases because of the high level of background noise. The metal box acts as electromagnetic wave shielding and reduces the external noise. When the loop antenna placed inside metal box, the measurement sensitivity increases because of the low level of background noise inside metal box.

Keyword—partial discharge, metal box, loop antenna

I. INTRODUCTION

High voltage insulation is the most important part of a high voltage equipment used in an electric power system. The main task of the insulation is to withstand a high electric field between phases or phase and neutral. In excessive high electric field due to the appearance of field enhancement sites like void or protrusion, partial discharge (PD) may occur. The appearance of discharges or leakage current in electrical insulations may indicate insulation aging and in long term this may further reduce the integrity of the insulation leading to the failure of the equipment[1-2]. Diagnosis of PD is considered to highly represent the actual condition of the equipment. PD measurement as described in IEC 60270 requires equipment to be shut down. PD measurement using a UHF antenna, offers benefit because it can be done in the online condition[3-26].

Meanwhile, most of the high voltage equipment was made in form of metal enclosed models. Metal-enclosed power switchgear is a switchgear assembly completely enclosed on all sides and top with sheet metal (except for ventilating openings, HV bushing and inspection windows) containing primary

power circuit switching or interrupting devices, or both, with buses and connections.

Since electrical parts inside metal enclosure is hard to be accessed, then one of the best way to detect PD inside metal enclosed electrical equipment is by using UHF sensors/antennas. This experiment compares PD occurrences inside of metal enclosures and PD occurrences with and without metal enclosures.

II. EXPERIMENTAL SETUP

A. Introduction

Experimental setup was arranged as shown in figure 1. Artificial PD source was put in the center inside aluminum box (sized 50 x 50 x 50 cm³) to simulate metal enclosed electrical equipment. Sensors that used to measure PD were loop antenna and HFCT. The loop antenna was placed inside metal box, 23 cm from PD source. The measurement result by loop antenna was compared with the measurement result by high frequency current transformer (HFCT). Then, the measurement was repeated with the aluminum box was removed.

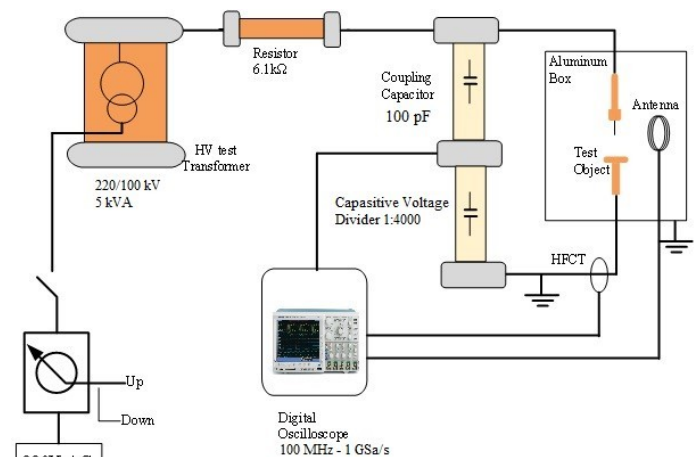


Figure 1. Experimental setup

Partial discharges occur when high voltage applied to the artificial PD source. The partial discharges voltage were detected by HFCT and loop antenna and measured by digital oscilloscope. The data from digital oscilloscope transferred to a personal computer for further analysis to show phase of PD occurrences, magnitude of discharges and PD pulse number which will be shown in $\Phi - q - n$ pattern.

B. Artificial PD source

The partial discharges signal were generated by artificial PD source using a needle-plane with a gap of 1.5 cm. The steel needle with tip radius of 10 μ m and curvature angle of 30°. This model generates corona discharges which is a type of partial discharge commonly found in high voltage insulation system. The needle-plane electrode kit is shown in figure 2. The electric field at the tip of the needle electrode is estimated by using the following equation[27]:

$$E_m = \frac{2V}{r \ln \left(\frac{4d}{r} \right)}$$

where V is the applied voltage, r is the radius of the needle tip and d is the electrode separation.

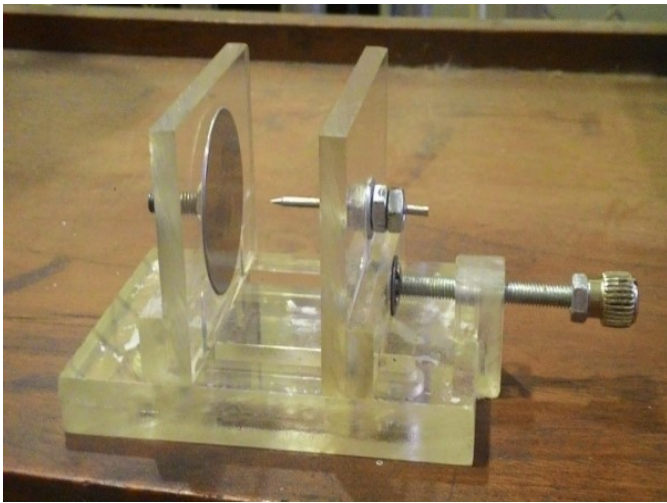


Figure 2. Needle-plane electrode system

B. PD charge calibration

PD charge calibration using a pulse calibrator was held before main experiment. The PD charge calibration process was done for HFCT sensors. To determine the apparent charge detected by loop antenna, comparison data from HFCT will be used. Figure 3 shows the result of PD charge calibration on HFCT.

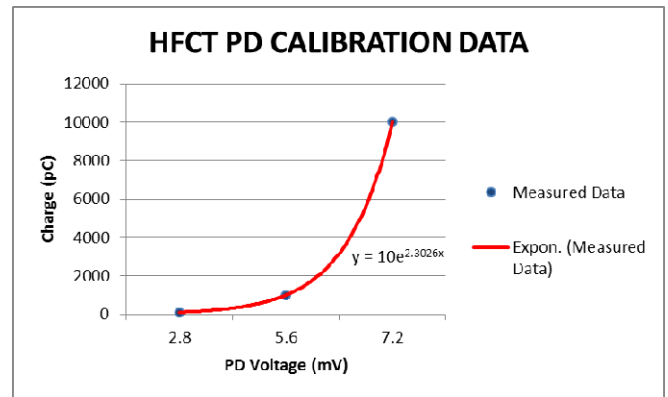


Figure 3. Charge calibration result of HFCT

The value of released charged when partial discharge occur detected by HFCT was the same value of the released charge read by loop antenna since the partial discharge generated from same electrodes and measured simultaneously.

C. Measurement Item

From this experiment, will be measured and obtained several parameters such as: PD inception voltage (PDIV): the minimum voltage when initial PD starts to occur; PD Waveform consists of V_{peak-peak}, V_{positive-peak} and V_{negative-peak}; PD Phase and charge magnitudes.

III. MEASUREMENT RESULTS

A. Partial Discharge Inception Voltage (PDIV)

The PDIV measurements was done by using loop antenna. The loop antenna was placed on the distance of 23 cm from the sensors. For the experiment without a box, PDIV detected by using the loop antenna is 3.73 kV. For the experiment using a box, PDIV detected by loop antenna is 3 kV experiment by using. The PD magnitudes V_{pp} at PDIV without metal box and with metal box detected by loop antenna are 42.4 mV and 20.8 mV.

B. PD waveform

Figure 4 shows negative PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level for the experiment without metal box.

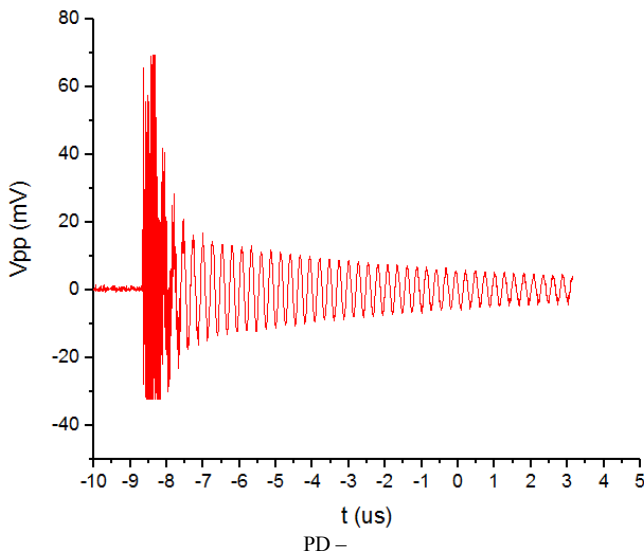


Figure 4 Negative PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level without metal box

Figure 5 shows positive PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level for the experiment without metal box.

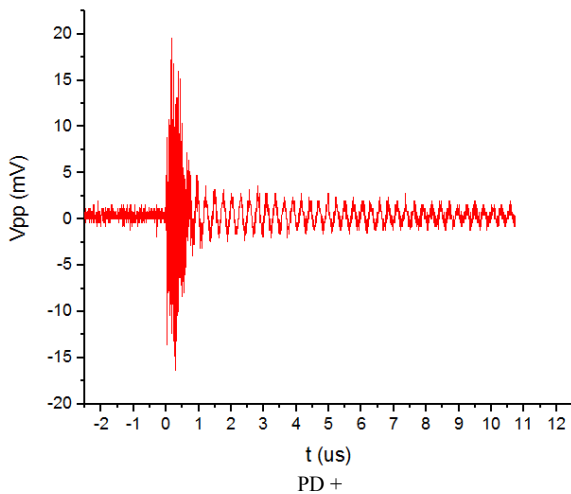


Figure 5 Positive PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level without metal box

Figure 6 shows negative PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level for the experiment with metal box (4b).

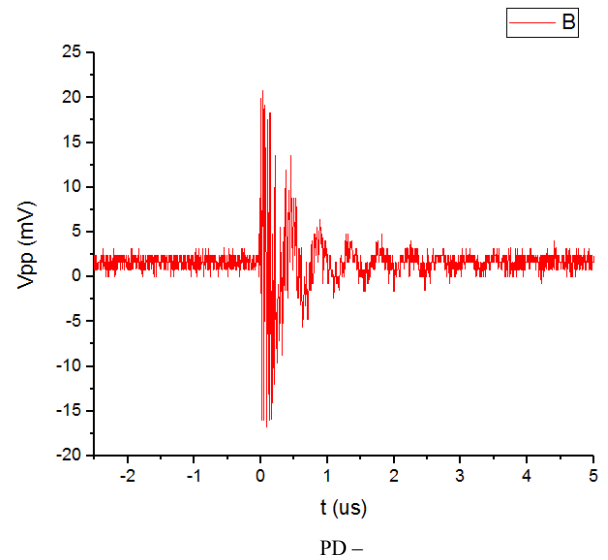


Figure 6 Negative PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level using metal box

Figure 7 shows positive PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level for the experiment with metal box.

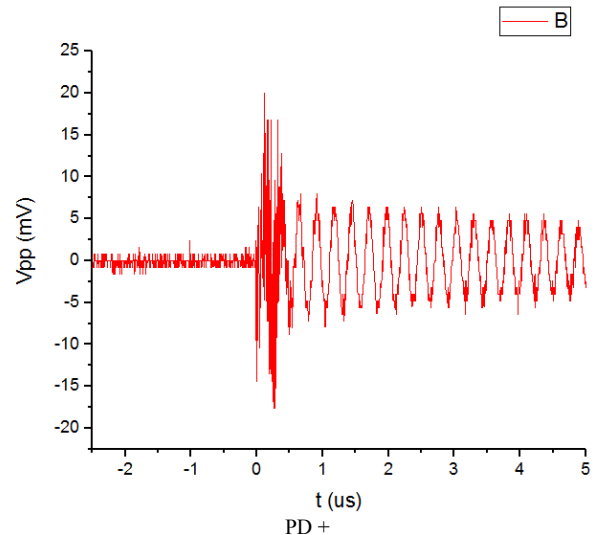


Figure 7 Positive PD waveform in the air (corona discharge) was measured by using antenna loop at 6 kV voltage level using metal box

C. PD pattern

The PD pattern (ϕ , V_{pp} , n) in the air (corona discharge) was measured by using antenna loop at 6-kV voltage level. Figure 8-9 shows PD Pattern measured by loop antenna at a distance of 23 cm without metal box and with metal box, respectively. The amount of PD that detected without using metal box and using metal box for each antenna is 288 and 436 pulse.

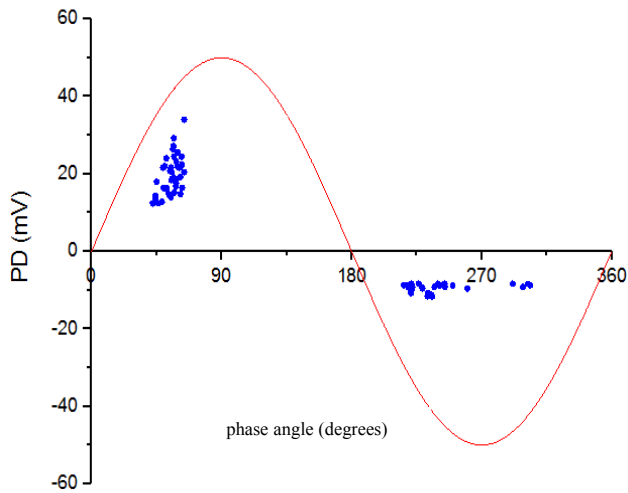


Figure 8 PD Pattern measured by loop antenna at a distance of 23 cm without metal box

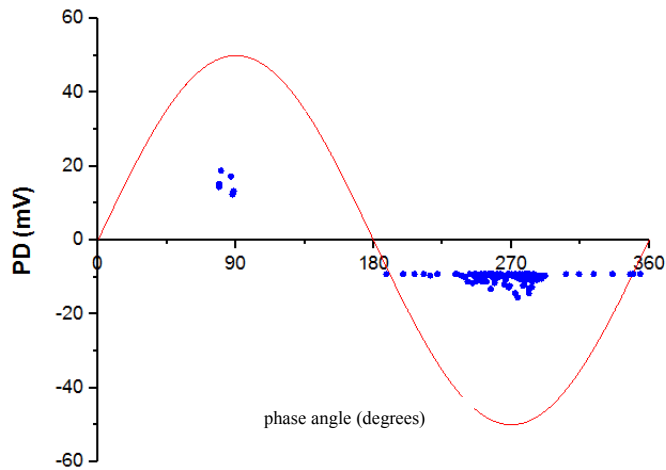


Figure 9 PD Pattern measured by loop antenna at a distance of 23 cm using a metal box (antenna was placed inside a box)

IV. ANALYSIS AND DISCUSSION

A. Comparison of Partial Discharge Detected by Internal Loop Sensor with and without Metal Box

Table 1 shows the comparison of background noise (V_{pp} BGN ON), negative PD inception voltage (PDIV-), V_{pp} detected by internal loop sensor with and without metal box at PDIV. BGN ON with box is lower than one without box. PDIV- with box is lower than one without box. V_{pp} at PDIV with box is lower than one without box.

Table 1. PDIV Parameters

Parameters	With Box	Without Box
V_{pp} BGN ON	10.5 mV	27.2 mV
PDIV -	3 kV	3.73 kV
V_{pp} at PDIV	12 mV	31.2 mV

These results are explained as follows. The metal box acts as the shielding of electromagnetic wave noise. The presence of the metal box reduces the external electromagnetic wave noise so that BGN ON in the presence of the metal box is lower than one without metal box. These result cause PDIV in the presence of metal box is lower than one without metal box.

Table 2 shows the comparison of V_{pp} of PD waveform, rise time of PD waveform (t_r), and fall time of PD waveform (t_f) detected by internal loop sensor with and without metal box at 6 kV applied voltage. V_{pp} of PD waveform at 6 kV with box is higher than one without box. Rise time of PD waveform at 6 kV with box is higher than one without box. Fall time of PD waveform at 6 kV with box is higher than one without box.

Table 2 PD Waveform at 6 kV

Parameters	With Box	Without Box
V_{pp} (mV)	79.2	69.6
t_r (ns)	15.593	10.137
t_f (μ s)	18.789	5.026

These results are explained as follows. In the presence of metal box the EM wave propagates and encounter metal box. In this situation the EM wave may be absorbed or reflected by metal wall. V_{pp} of PD waveform at 6 kV with box is higher than one without box because of the superposition of the EM wave reflected by the wall of metal box.

Table 3 shows PD number and PD maximum detected by internal loop sensor with and without metal box. Number of PD with box is more than one without box. Maximum PD with box is higher than one without box.

Table 3 PD Pattern at 6 kV

Parameters	With Box	Without Box
$\sum$ PD	436	288
PD max (mV)	79.2	69.6

These results are explained as follows. The lower of BGN in the presence of metal box increases the PD measurement sensitivity so that the number of PD detected by loop antenna in the presence of metal box is more than without metal box.

B. Effect of the Presence of Metal Box on Partial Discharge Detected by Internal Loop Sensor

The measurement results shows that the application of metal enclosure gives significant change to the PD occurrences detection by the UHF sensor (loop antenna). Detection of PD occurrences when the loop antenna placed inside metal enclosure makes the sensitivity of PD occurrences of the loop antenna increase due to the low level of background noise inside metal enclosure. While, when the loop antenna placed outside metal enclosure, the sensitivity of the antenna decreased due to the high level of background noise.

III. CONCLUSION

This paper discussed the measurement of partial discharge inside metal enclosed power apparatus using internal sensor.

The results are concluded as follows:

1. Application of metal enclosure gives significant change to the PD occurrences detection by loop antenna.
2. Detection of PD occurrences when the loop antenna placed inside metal enclosure makes the sensitivity of PD occurrences of the loop antenna increase, since the low level of background noise inside metal enclosure.
3. When the loop antenna placed outside metal enclosure decrease the sensitivity of the antenna since the high level of background noise.

REFERENCES

- [1] H. Illias, T. S. Yuan, A. Halim, A. Bakar, G. Chen and P. L. Lewin, "Partial Discharge Patterns in High Voltage Insulation," in *IEEE International Conference Power Energy*, 2012.
- [2] S. Tenbohlen, D. Denisov, S. M. Hoek and Z. Ring, "Partial Discharge Measurement in the Ultra High Frequency (UHF) Range," *IEEE*, Vols. 15, no. 6, pp. 1544-1552, 2008.
- [3] Abrar Hakim, Umar Khayam "Design of Planar Goubau Line Antenna for Detecting Partial Discharge in GIS", ", Proceeding of IEEE International Conference on Renewable Energy and Power Engineering – ICPERE 2016, Yogyakarta, Indonesia, November 28-30, 2016.
- [4] Bayu M. Amna, Umar Khayam, "Design and Simulation of High Frequency Current Transformer as Partial Discharge Detector", Proceeding of IEEE International Conference on Renewable Energy and Power Engineering – ICPERE 2016, Yogyakarta, Indonesia, November 28-30, 2016.
- [5] Umar Khayam, Fakhri Alfaruq, "Design of Hilbert Antenna as Partial Discharge Sensor", The Second International Conference Industrial, Mechanical, Electrical and Chemical Engineering (IMECE), Yogyakarta, Indonesia, October 6-7, 2016.
- [6] Fakhru Rozi, Umar Khayam, "Design of Loop Antenna as Partial Discharge Sensor", International Journal of Electrical Engineering and Informatics Vol 7 No. 1, 2015.
- [7] Khusnul Khotimah, Umar Khayam, Suwarno, Yuki Tai, Masahiro Kozako, Masayuki Hikita, "Design of Dipole Antenna Model for Partial Discharge Detection in GIS", The 5th International Conference on Electrical Engineering and Informatics 2015 August 10-11, 2015, Bali, Indonesia.
- [8] Umar Khayam, Ibrahim Alhanif, "Design of RC Circuit as Partial Discharge Detector", Joint International Conference on Electric Vehicular Technology (3rd ICEVT 2015) and Industrial, Mechanical, Electrical, and Chemical Engineering (IMEC-E 2015), Solo, Indonesia, 2015.
- [9] Nhethra, Umar Khayam, "Measurement of Partial Discharge in Needle-Plane Electrode using RC detector, HFCT, and Antenna Sensors", Joint International Conference on Electric Vehicular Technology and Industrial, Mechanical, Electrical and Chemical Engineering (ICEVT & IMECE), Solo, Indonesia, 2015.
- [10] Nhethra, Umar Khayam, "Partial Discharge Measurement of 4 Types of Electrodes Configuration in Air Insulation using High Frequency Current Transformer Sensor", Joint International Conference on Electric Vehicular Technology and Industrial, Mechanical, Electrical and Chemical Engineering (ICEVT & IMECE) 2015.
- [11] Muhammad Anung Darmawan, Umar Khayam, "Design, Simulation, and Fabrication of Second, Third, and Fourth Order Hilbert Antenna as Ultra High Frequency Partial Discharge Sensor", Joint International Conference on Electric Vehicular Technology and Industrial, Mechanical, Electrical and Chemical Engineering (ICEVT & IMECE) 2015.
- [12] Farrah Vauzia, Suwarno, Umar Khayam, "Design and Implementation of Double Layer Printed Bow-Tie Antenna as UHF Sensor For Partial Discharge Measurement", International Conference on Sensor, Sensor System, and Actuator, ICSSA 2014-001, Bandung, May 2014.
- [13] Suwarno, Farrah Vauzia, Umar Khayam, "Application of New Designed Bow-Tie Antenna as UHF Sensor For Partial Discharge Measurement In GIS", International Conference on Sensor, Sensor System, and Actuator, ICSSA 2014-002, Bandung, May 2014.
- [14] Inu Suprianto, Umar Khayam, Suwarno, Kiichi Nishigouchi, Masahiro Kozako, Masayuki Hikita, "Design and Implementation of Small Glasses Model as UHF Sensor to Detect Partial Discharge in Gas Insulated Switchgear", International Conference on Sensor, Sensor System, and Actuator, ICSSA 2014-008, Bandung, May 2014.
- [15] Inu Suprianto, Umar Khayam, Suwarno, Kiichi Nishigouchi, Mohamad Kamarol, Masahiro Kozako, Masayuki Hikita, "UHF Sensor Optimization used for Detecting Partial Discharge Emitted Electromagnetic Wave in Gas Insulated Switchgear", International Symposium on Electrical Insulating Material (ISEIM), Paper VA13, pp. 330-333, Japan, May 1-5, 2014.
- [16] Asep Andi Suryandi, Umar Khayam, "New Designed Bowtie Antenna with Middle Sliced Modification as UHF Sensor for Partial Discharge Measurement", International Conference on Smart Green Technology in Electrical and Information Systems (ICSGTEIS), Paper 77, pp. 98-101, Bali, November 5-7, 2014. ISBN : 978-1-4799-6125-2
- [17] Asep Andi Suryandi, Umar Khayam, "Design of Modified Bow-tie Antennas for Partial Discharge Measurement", 2014 IEEE Joint International Conference on Electrical Engineering and Computer Science and the Second International Conference on Electric Vehicular Technology, Paper 44, 24-25 November 2014, Bali, Indonesia. 978-1-4799-8478-7/14/\$31.00 ©2014 IEEE.
- [18] Fakhru Rozi, Umar Khayam, "Design of Circle Shaped Loop Antenna as Partial Discharge Sensor", 2014 IEEE Joint International Conference on Electrical Engineering and Computer Science and the Second International Conference on Electric Vehicular Technology, Paper 130, pp. 420-423, 24-25 November 2014, Bali, Indonesia. 978-1-4799-8478-7/14/\$31.00 ©2014 IEEE.
- [19] Umar Khayam, Farrah Vauzia, Suwarno, "Design, Fabrication, and Testing of Double Layer Printed Bow-Tie Antenna as Partial Discharge Sensor in Gas Insulated Switchgear", The 2nd IEEE Conference on Power Engineering and Renewable Energy ICPERE 2014, Paper 10B1-1, Bali, December 9-11, 2014.
- [20] Asep Andi Suryandi, Umar Khayam, "Design of New Shape of Bowtie Antenna with Edge Modification for UHF Partial Discharge Measurement", ", The 2nd IEEE Conference on Power Engineering and Renewable Energy ICPERE 2014, Paper 11B1-1, Bali, December 9-11, 2014.
- [21] Fakhru Rozi, Umar Khayam, "Design, Implementation and Testing of Triangle, Circle, and Square Shaped Loop Antennas as Partial Discharge Sensor", The 2nd IEEE Conference on

- Power Engineering and Renewable Energy, ICPERE 2014, Paper 11B1-5, Bali, December 9-11, 2014.
- [22] Hanalde Andre, Umar Khayam, "Perancangan Antena Kupu - Kupu sebagai sensor Ultra High Frequency (UHF) untuk mendeteksi Partial Discharge (PD) pada Gas Insulated Substation (GIS), Jurnal Nasional Teknik Elektro Vol. II No. 2, Sep. 2013.
 - [23] Sriyono, Yong-Joo Kim, Umar Khayam, Suwarno, Masayuki Hikita, "Characteristics of External Loop Sensor Located near Bushing on Partial Discharge Induced Electromagnetic Wave Measurement", International Journal on Electrical Engineering and Informatics - Volume 5, Number 1, pp. 12-23, March 2013.
 - [24] Joko Muslim, Suwarno, Umar Khayam, Masayuki Hikita, "Improvement of Bowtie UHF Antenna Model for Detecting PD in GIS," Procedia Technology, 8C, pp. 217-224. International Conference on Electrical Engineering and Informatics, Malaysia, June 24-25, 2013.
 - [25] Joko Muslim, Suwarno, Umar Khayam, Masayuki Hikita, "Enhanced Bowtie UHF Antenna for Detecting Partial Discharge in Gas Insulated Substation" 48th Universities' Power Engineering Conference - UPEC2013, Dublin, Ireland, September 2-5, 2013.
 - [26] Hanalde Andre, Umar Khayam, "Design of New Shape Printed Bowtie Antena for Ultra High Frequency Partial Discharge Sensor in Gas-Insulated SubstationsI, International Conference on Information Technology and Electrical Engineering, pp. 365-369, Yogyakarta, October 7-8, 2013.
 - [27] Suwarno, "Partial Discharge in High Voltage Insulating Materials," *International Journal Electrical Engineering and Informatics*, Vols. 8, no. 1, pp. 147163, 2016.